


RAZOR HD Gen II EBR-2C MRAD Reticle Subtensions for 4.5-27x56

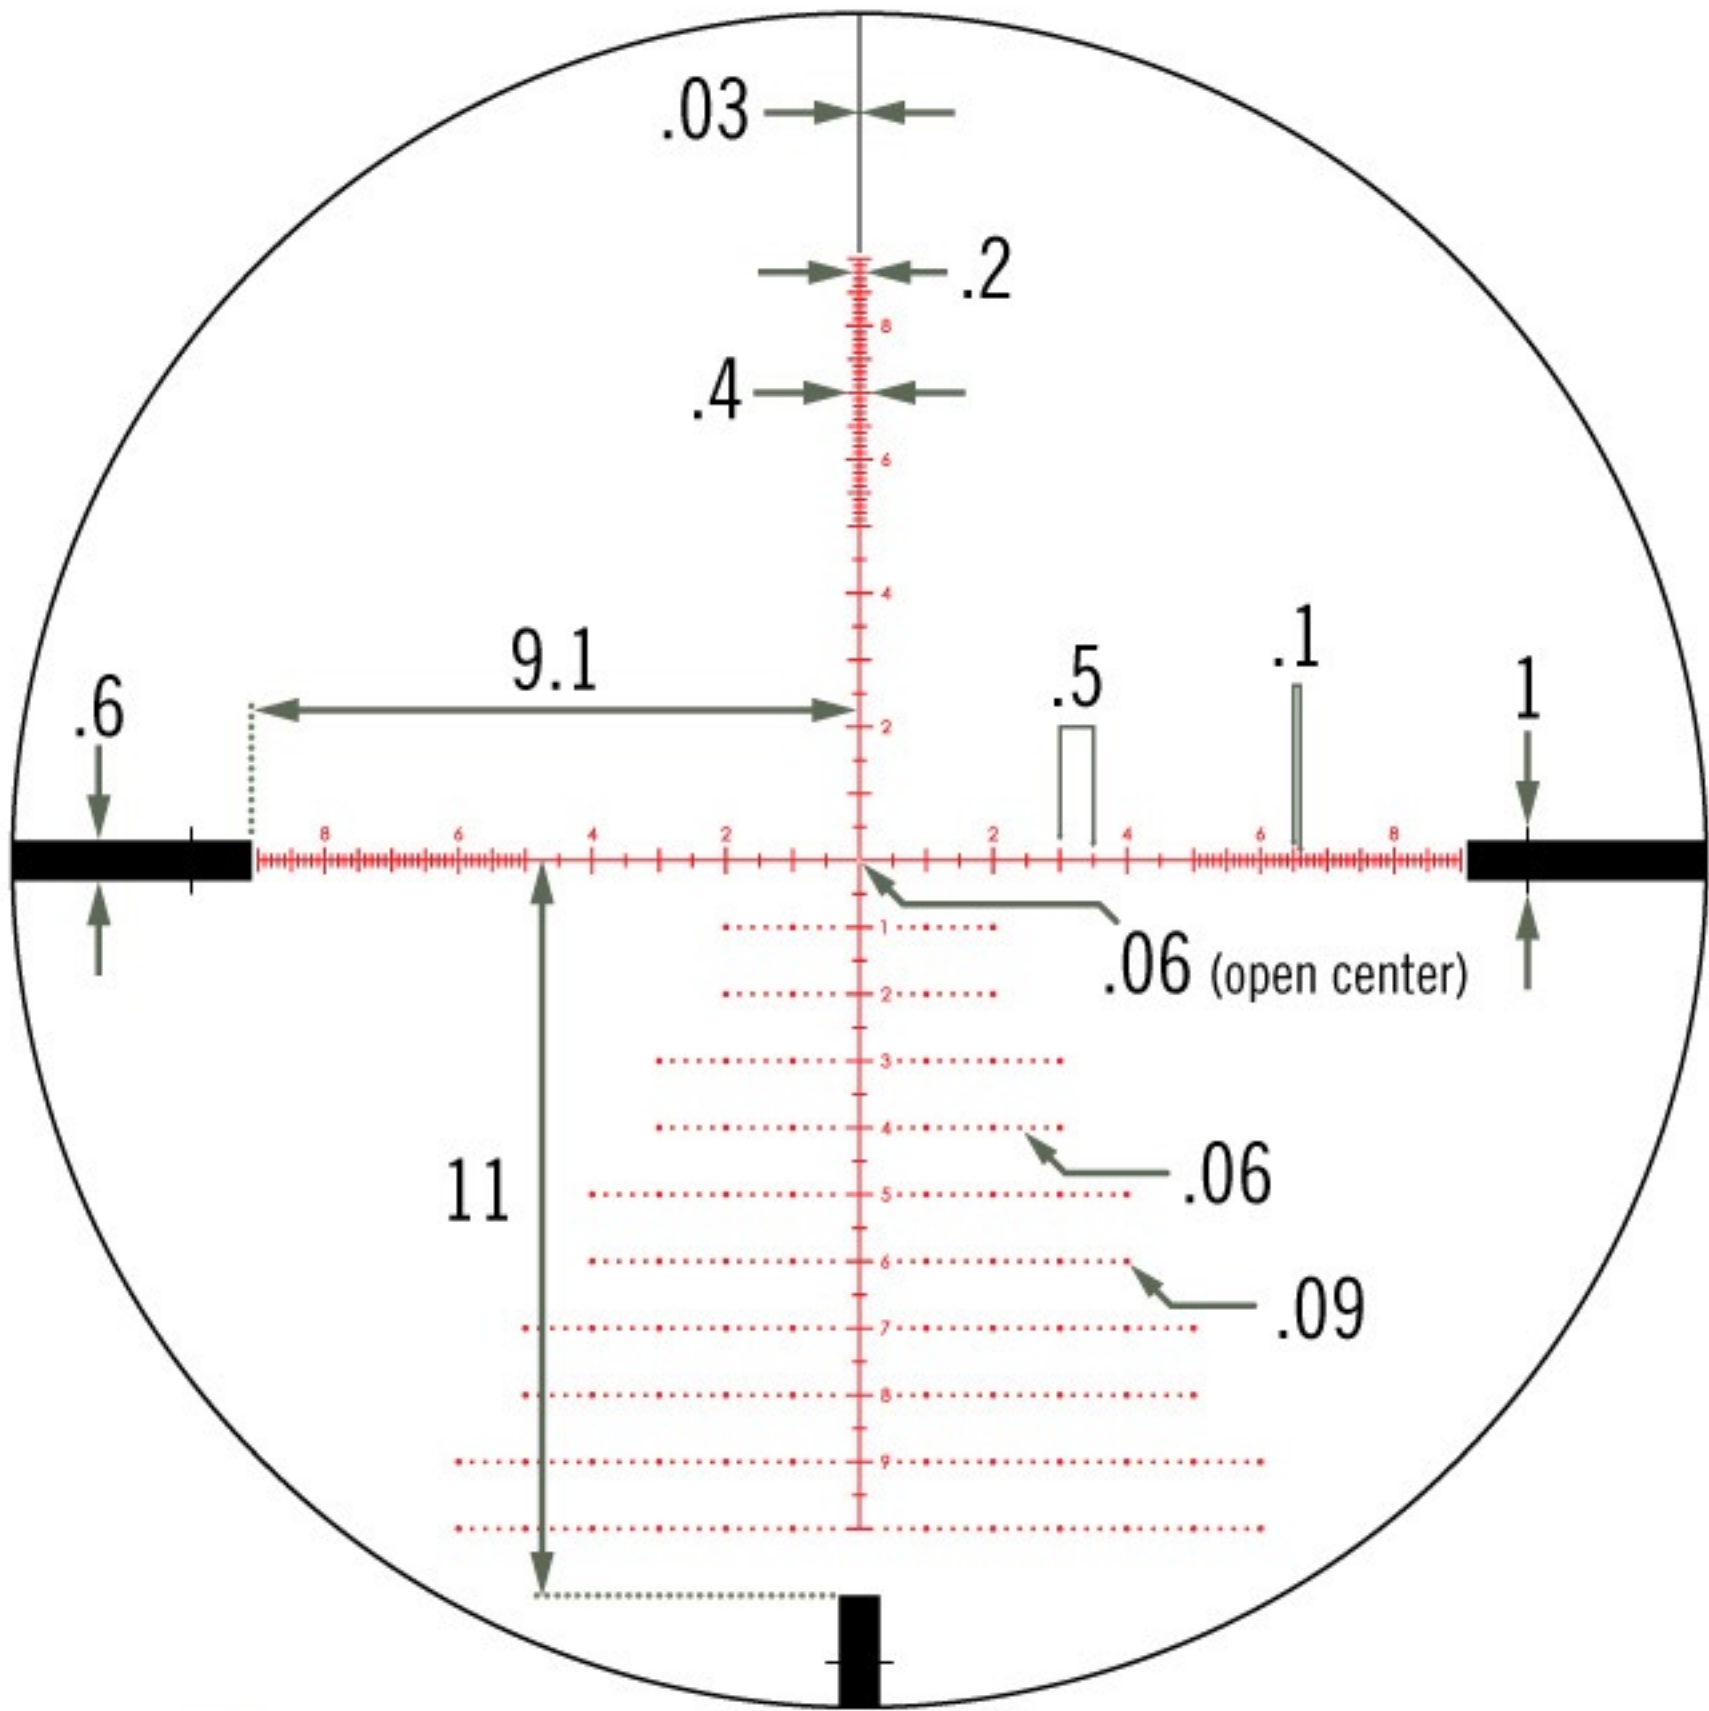

.....[NOTES].....

Subtensions are measured in MRAD and remain constant at all magnifications.

Reticle image shown for representation only. The overall reticle image will vary with changes in the magnification.